


HOW TO ORDER SPIRAL DUCT GRILLES

Type of Ducts


The spiral duct grilles are typically installed on spiral round duct but it can also be installed on the round portion also known as the minor axis of the flat oval duct.

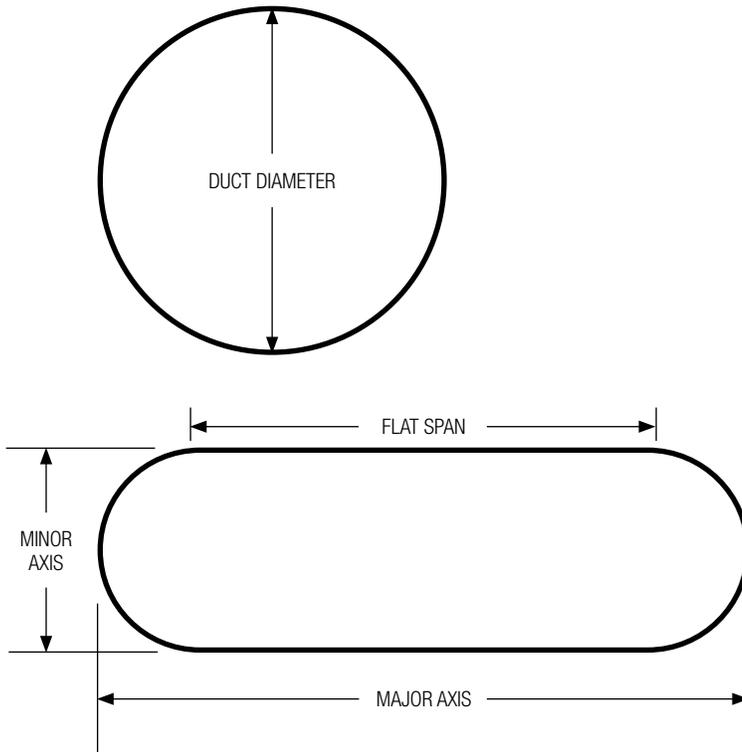

Example: If the height for the minor axis (round portion) is 10", the duct diameter for the spiral duct grilles is 10".

Double Wall

For double walled ducts, the duct diameter for the spiral duct grille is ordered based on the outer duct diameter. Confirm that the nominal width of the grille is less than the inner duct diameter to ensure proper fit. Contact grd@priceindustries.com if you have questions.

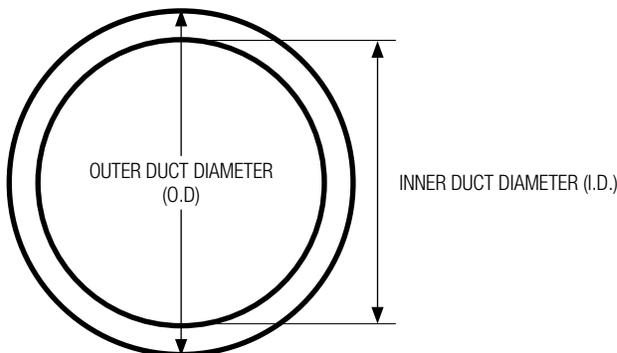

SECURITY GRILLE WEIGHTS

How to order SDGE/SDGER

Use the table below to determine which nominal width will work for your duct.

Available SDGE Sizes						
Duct Diameter	Nominal Widths					
	3	4	6	8	10	12
6"	X	X				
8"	X	X	X			
10"	X	X	X	X		
12"	X	X	X	X	X	
14" to 36"	X	X	X	X	X	X

Example: For 12" duct diameter, the SDGE can be ordered with nominal widths of 3", 4", 6", 8" and 10".

How to order SDG/SDGR

Use the table below to determine which nominal width will work for your duct.

Available SDG Sizes									
Duct Diameter	Nominal Widths								
	4	5	6	7	8	9	10	11	12
8" - 13"	X								
14" - 21"	X	X	X						
22" - 31"	X	X	X	X	X				
32" - 41"	X	X	X	X	X	X	X		
42" - OVER	X	X	X	X	X	X	X	X	X

Example: For an 18" duct diameter, the nominal width for the SDG/SDGR should be between 4" to 6".